

**PRASAR BHARATI  
(BROADCASTING CORPORATION OF INDIA)  
DIRECTORATE GENERAL; ALL INDIA RADIO  
(PLANNING & DEVELOPMENT UNIT)**

\*\*\*\*\*

F. No: 27/12/1/Srinagar/SETC /Diplexer /2008-D(TD/FM)

Specification for Supply, erection, testing and commissioning (SETC) {of diplexer & RF Coaxial Copper Rigid Lines & accessories} {Site-Radio Kashmir, Srinagar}  
{Specification no: SETC diplexer /30/Srinagar/November/2008- D (TD/FM)}

[Total number of pages – 16 ]

**CONTENTS**

<b>SECTION 1.0 TECHNICAL REQUIREMENTS</b>	: (Page number 3 )
<b>SECTION 2.0 GENERAL SPECIFICATIONS</b>	: (Page number 4 to 9 )
<b>SECTION 3.0 TECHNICAL SPECIFICATIONS</b>	
<b>3.1 DIPLEXER</b>	: (Page number 10 to 12 )
<b>3.2 RF COAXIAL COPPER RIGID LINES &amp; ACCESSORIES</b>	:(Page number 13)
<b>SECTION 4.0 INSPECTION</b>	: (Page number 14)
<b>SECTION 5.0 SCHEDULE OF SUPPLY, ERECTION, TESTING &amp; COMMISSIONING</b>	: ( Page number 15 ) and : Drawing No.TM-15832(Page-16)

**N.B. :**

- 1. The Tenderer shall submit technical bid alongwith schedule of material /requirement of SETC without price as in Section 4.0 & Section5.0 of AIR Specification (two bid system i.e. technical bid and commercial bid).**
- 2.Each statement of this specification has to be complied with & supported by printed literature/data sheets from the manufacturer of the equipment by the tenderer, without which tender will be considered incomplete & is liable to be rejected. The tenderer should make a detailed offer.**

**3. All the technical details , Schematic drawings and schedule of requirement/material must be submitted and enclosed with the tender by the tenderer failing which the tender is liable to be rejected.**

**4. The tenderer shall submit the tender offer to AIR in the format given below .**

<b>Sr. No. of AIR Spec. Section wise &amp; Clause wise</b>	<b>Details of AIR Spec.</b>	<b>Make &amp; Model No of the Equipment offered</b>	<b>Performance figures of equipment and schematic drawing Nos.</b>	<b>Compliance Yes/NO</b>	<b>Ref to tender page No.</b>	<b>Remarks</b>
Section 1.0						
Section 2.0						
Section 3.0						
Section 4.0						
Section 5.0						

**5. Tenderer shall quote the rate / cost of individual items in the tender offer while submitting the offer for spares in commercial bid.**

**6. The complete technical compliance must be signed & stamped by the Original Equipment Manufacturer(OEM) of the equipment in the tender document. In case tender offer is from other than the Original Equipment Manufacturer, the tenderer must also sign & stamp each page of the compliance statement. The OEM & tenderers shall fill up their name in CAPITAL LETTERS, full address with pin code , phone number, fax number, e-mail address and with their full signatures , failing which the tender shall be liable for rejection.**

## **SECTION 1.0 TECHNICAL REQUIREMENTS**

SITE---- Radio Kashmir, Srinagar

<b>S. No</b>	<b>Project</b>	<b>Diplexer</b>	<b>RF Coaxial Copper rigid lines&amp; accessories required</b>	<b>Reference to SECTION of AIR Specification</b>
1.	Radio Kashmir, Srinagar (2 <sup>nd</sup> FM Channel)	1No.	Yes	5.0

## SECTION 2.0 GENERAL SPECIFICATION

**Note : Please refer tender documents for general terms and conditions of contract for SETC works including all the commercial aspects like ;** Packing and Packing List, Insurance and Marine Risk etc., Payment terms, Penalty/Compensation for Delay, Damages and Liabilities, Time Period and Extension for Delay , Foreclosure of Contract due to Abandonment or Reduction in Scope of Work, Cancellation of Contract in Full or Part, Recovery of Security Deposit, Performance Guarantee, Indian Electricity Rules ,Unsatisfactory Workmanship, Damages Incurred During Erection , Tenderer Liable for Damages, Defects, Recovery of Compensation, Ensuring Payment and Amenities, Labour Laws to be Complied by Tenderer, Minimum Wages Act Compliance, Tenderer to Indemnify Government against Patent Rights, Return of Surplus Material, Employment of Technical Staff and Employees, Release of Security Deposit, Safety Code, insurance from manufacturer's works/factory to site etc **i.e. in totality** .

### **GENERAL SPECIFICATIONS :**

All equipment and items of SETC as per AIR specification shall be used for 24x7 operation.

Each statement of this specification has to be complied with & supported by printed matter from the manufacturer of the equipment by the Tenderer .

#### 1.0 SCOPE:

Supply, erection, testing and commissioning (SETC) of diplexer, RF Coaxial Copper Rigid Lines & accessories as per AIR specification.

The broad scope of above supply, erection, testing and commissioning (SETC) are as follows:

1.1 Diplexer as per specification.

1.2 RF Coaxial Copper Rigid Lines as per specification.

2.0 For completion of the SETC all items, fittings and accessories which are necessary for the setup , which may not have been specifically mentioned or which the Tenderer may not explicitly mention in the tender but all the same are necessary for the operation of the equipment shall be deemed to be included in the tender and shall be provided by the successful Tenderer without any additional payment by the Indentor . The full technical details and technical literature/ pamphlets shall be submitted by the Tenderer.

3.0 INSPECTION: Inspection will be as per details given in Annexure I of AIR Specification by the representative of All India Radio at manufacturer's works.

Before giving the call for inspection to the Indentor, the Original Equipment Manufacturer (OEM) & Tenderer (in case tenderer happens to be different from OEM) should satisfy themselves that the offered equipment etc. are as per the AIR Specification and approved drawings. OEM & Tenderer shall submit one set of complete performance figures as per ATP to the Indentor before giving call for inspection to the Indentor.

Prior intimation for carrying out inspection and pre-despatch performance test as per ATP at manufacturer's works is to be given by the OEM to the Indenter at least 6 weeks in advance.

The total inspection period for Diplexer shall be 2 working days (for diplexer and RF Coaxial Copper Rigid Lines & accessories etc. ). Expenses for inspection charges on account of providing of infrastructure are to be quoted separately. For AIR Inspecting Engineers expenses toward to and fro air journey, boarding, lodging etc will be borne by All India Radio.

Acceptance Test Procedure will be submitted by the Tenderer with in one month of placement of order for approval of AIR in respect of all the equipment /items. This will include all tests so as to assess the performance of the equipment vis-à-vis all specifications.

Diplexer will be tested at specified Ambient Temperature.

4.0 The successful Tenderer shall supply within one month from the date of placement of the order, 2 sets of complete design & drawing documents in respect of the setup for the approval of AIR. Tenderer should submit detailed design, complete drawings with full details as per the specification.

5.0 DESIGN & DRAWING DOCUMENTS :

( **Total 3 sets** )

{ SITE - Srinagar }

After approval of all the design document and drawings of complete set up by AIR as at 4.0 above the successful Tenderer shall send **one set** of all above complete drawing documents to Superintending Engineer/Installation officer, Radio Kashmir, Srinagar;

( TOTAL - 1 SET)

**one set** of the above documents to the Chief Engineer of the Zone (NZ) and

( TOTAL - 1 SET)

**one set** of the above documents to Director Engg.(Proj.), P&D Unit, DG, AIR, New Delhi-110001 ( TOTAL - 1 SET)

**i.e. in brief, total 3 sets** of such drawings and design document are required against SETC.A soft copy of these documents on CD shall be provided to DE(Proj.), P&D Unit, DG:AIR, New Delhi by the Tenderer.

- 6.0 All the necessary measuring equipment and tools etc. required for completion of Erection of the project will be arranged by the Tenderer during SETC and no additional amount shall be paid on this account.
- 7.0 Erection, testing and commissioning (ETC) of above “set-up” as per specification shall be done by a Qualified Engineer of OEM of Diplexer at site.
- 8.0 The Tenderer should either be original equipment manufacturer or supply the equipment only from the original equipment manufacturer. Original manufacturers should have ISO certification for the manufacturing work and the documentary proof for all above are to be enclosed by the Tenderer with the Tender paper/documents.
- 9.0 DELIVERY PERIOD FOR SUPPLY, ERECTION, TESTING & COMMISSIONING:  
6 months from the date of placement of order.
- 10.0 All information submitted by the Tenderer & all markings, notes, designation on the design, drawing documents & associated write-ups shall be in "English language" only. All dimensions and units on drawings and all references to weights and measures shall be in MKS.
- 11.0 Complete printed technical information in support of compliance statement should be furnished with the tender to assess the full merit of the offer. The tender & the associated information should be submitted in duplicate.
- 12.0 Descriptive information giving complete details of each equipment offered shall be given by the Tenderer.
- 13.0 Make, model and type of individual units along with printed technical details shall be given by the Tenderer.
- 14.0 The Tenderer shall make his own arrangements for providing accommodation for his workmen at site.
- 15.0 The Tenderer should conform to all local State laws/Central laws and regulations amended up to date concerning labour and their employment as applicable. The insurance etc of the labourers shall be the responsibility of the Tenderer including any kind of pre /post action and consequences relating to above insurance etc.
- 16.0 The Tenderer shall indemnify the purchaser, his employees and purchaser employees from any liability that may arise out of infringements of patents and copy rights associated with the design, fabrication, erection of any equipment etc.
- 17.0 The Tenderer is required to submit details of his previous experience in similar Supply of such Equipments i.e. the capacity of their organizational set up.

18.0 Tenderer shall submit detailed Supply, erection, testing and commissioning schedule of equipment/requirement offered as per specification. This list should be in the same format as in the price bid minus the price.

19.0 HANDING OVER OF DETAILED MANUALS & DRAWINGS:

19.1 At the time of handing over, the Tenderer shall hand over technical manuals (for erection, testing, commissioning, Operation, maintenance & theory of operation manuals, fault diagnostic with a copy of the Inspection Report carried out at factory and performance measurement carried out at the time of commissioning on site) to the following:- **(Total :6 Sets)**

19.1.1 DE (Projects), P&D Unit, DG: AIR, New Delhi with One soft copy on CD of all these manuals, drawings, instructions, performance measurements, amendments, etc. **one set (TOTAL- 1 set)**

19.1.2 **Chief Engineer (North Zone): - one set (TOTAL- 1 set)**

19.1.3 *Site consignee - The Superintending Engineer* :**(TOTAL- 1 set)**  
The Superintending Engineer, Radio Kashmir, Srinagar

19.1.4 At the time of handing over, the Tenderer shall also hand over technical manuals of diplexer, RF Rigid Lines & accessories for erection, testing, commissioning, operation, maintenance & theory of operation and fault diagnostic to the following.

19.1.4.1 DE(Transmitter Maintenance), DG:AIR	- 1 sets
19.1.4.2 Technical Library, P&D Unit, DG:AIR	- 1 sets
19.1.4.3 Staff Training Institute (Technical)	- 1 sets
Total	- <u>3sets</u>

20.0 In support of Tenderer's claim an "up-to-date" list of their customers alongwith complete set of detailed actual performance figures for project similar to AIR Specification (duly certified by the customers) must be furnished alongwith the tender. Names, Address, E-mail, telephone nos. and Fax numbers of customers must be given.

21.0 In case of 'kits' complete details of all components that form part of kit should be spelt out/clearly given i.e. the details of the component/item offered in the kit including their part no. and quantities.

22.0 INFORMATION TO PRECEDE DESPATCH OF EQUIPMENT:

Following information should be supplied to Indentor and each of the consignees, prior to dispatch of equipment:

22.1 Detailed list of equipment under dispatch .

22.2 Photographs, detailed engineering drawings showing location/details of components in the various units and sub units with Item/part number marked thereon.

23.0 After completion of work the Tenderer shall remove dust, dirt, debris and leave the building/premises in a clean condition .

24.0 SUPPLY, ERECTION, TESTING AND COMMISSIONING :

The SETC of diplexer, RF Coaxial Copper Rigid Lines & accessories shall be undertaken by the Tenderer in accordance with ATP and in conformity with the AIR Specification.

24.1 SUPPLY: Supply of diplexer, RF Coaxial Copper Rigid Lines & accessories etc. shall be as per SECTION 5.0 of AIR Specification.

24.2 ERECTION: diplexer , RF Coaxial Copper Rigid Lines & accessories ( as per SECTION 5.0) at site will be done in the Studio complex as per layout plan approved by AIR.

24.3 TESTING:

Diplexer, RF Coaxial Copper Rigid Lines & accessories and associated equipment are to be tested after the erection, after making all the initial checks including physical inspection and continuity checks of wiring/cabling etc. as per drawings. Only after satisfying that erection is fit for testing (without the application of RF power), the testing will be taken up with RF power in a sequential manner in respect of all the equipment. The testing will be undertaken by the Tenderer as per standard practice and in conformity with procedure laid down in ATP.

24.4 COMMISSIONING AT SITE: After erection and testing of diplexer, RF Coaxial Copper Rigid Lines & Accessories, performance figures/measurement for all parameters are to be taken by the Tenderer in the presence of AIR's representative as per approved ATP.

25.0 In case of any tender where unit rate of any item/items appears unrealistic, such tender will be considered an unbalanced and in case the Tenderer is unable to provide satisfactory explanation , such a tender is liable to be disqualified and rejected.

26.0 On acceptance of the tender, the name of the accredited representative(s) of the Tenderer who would be responsible for taking instructions from DG:AIR ,New Delhi-110001 or his authorized representative shall be communicated in writing to Indentor.

27.0 **Experience (Supply)**: Minimum 10 years experience of OEM in production of the products quoted.



## SECTION 3.0 TECHNICAL SPECIFICATIONS

### 3.1 SPECIFICATION OF DIPLEXER:

- Exact frequencies of both transmitters for feeding to narrow band inputs (NB) will be intimated at the time of placement of order.

- Diplexer is required by AIR for combining the power of two VHF FM Transmitters operating on different frequencies for feeding into a single Antenna.
- The Diplexer shall be complete with reject loads, by-pass patch panel, metering panel, interlock circuit, LED mimic diagram and all connection with rigid lines etc mounted on a MS channel frame as per schematic diagram Drawing No.TM-15832.*
- The Diplexer shall be of compact & rugged design & with minimum floor area requirements. It should have natural ventilation cooling. Diplexer modules should be mounted on sturdy, unitized frames.
- The Diplexer shall be of balanced Band Pass Constant Impedance design. Filter cavities should be constructed of high grade aluminium & inner probes inside cavities should be constructed of high grade copper. The tunable probes should be attached to the cavity top with temperature compensated invar rods.
- The individual filter should be tunable in the frequency range and tuning control should be lockable. It should be possible to easily retune the Diplexer at site to a new frequency within the frequency band of 88-108 MHz.  
The cavity plunger position vis-à-vis frequency graph to be provided. Probe will be given graduation marking and shall be lockable.  
Full details including illustration schematic diagrams are to be given with Tender.
- TECHNICAL SPECIFICATION:

SNo.	TECHNICAL PARAMETER	SPECIFICATION
i)	No. of inputs	
	a)Narrow band input for two transmitter(NB)	2 numbers
	b)Emergency wide band input for two transmitters(WB)	2 numbers To be provided (it should be possible to put through any of the two Transmitters in case of failure of any input module of Diplexer).
ii)	Average Power into each NB input	15 KW
iii)	Average Power into each WB input.	20 KW
iv)	Average Output power rating Combined wideband output	35 KW
v)	Input Impedance for each input	50 Ohms
vi)	Output Impedance	50 Ohms

vii)	Carrier frequency of Transmitters	Exact frequencies of both transmitters will be intimated at the time of placement of order, However it may be necessary to change the frequencies in the band 88 -108 Mhz
viii)	Frequency range of operation	88-108 MHz.
ix)	Channel Separation	800 KHz
x)	Constant impedance bandwidth	(+/-) 150 KHz off carrier.
xi)	a)Insertion Loss for Narrow band (NB) input	< 0.3 dB
	b) Insertion Loss ( between Wide Band Input to the output )	≤ 0.1 dB
xii)	Isolation (between inputs) at channel spacing 800KHz. <ul style="list-style-type: none"> <li>• Narrow band to Narrow band (NB to NB)</li> <li>• Narrow band to Wide band (NB to WB)</li> <li>• Wide band to Narrow band (WB to NB)</li> </ul>	Better than 50 dB Better than 32 dB Better than 50 dB
xiii)	<u>Return Loss</u>	
	a)Narrow Band Input	Better than 26 dB for $f_c \pm 150$ KHz
	b)Wide Band Input	Better than 26 dB at a separation of 800KHz for the entire FM band II
xiv)	Group delay	25 n sec. for (+/-) 100 KHz
xv)	frequency response $\pm 150$ KHz	Within $\pm 0.1$ dB
xvi)	Connectors Size	
	a)Narrow Band Input	3-1/8" EIA unflanged male
	b)Wide Band Input	3-1/8" EIA unflanged male
	c)Combined Output	3-1/8" EIA unflanged male
xvii)	U-Link Patch Panel	The Diplexer is to be provided with U-Links & shorting switches so that it is possible to by-pass any of its defective modules and feed any of the two Transmitters into the Wide band Input Port. Details schematic diagrams should be included with tender.
xviii)	Ventilation	Natural air ventilation
xix)	Ambient Temperature	-10° C to 45° C
xx)	Humidity	95 %

7. MECHANICAL DATA:

i)	Dimensions	(H)	≤ 3200 mm
		(W)	≤ 1600 mm
		(D)	≤ 2000 mm

8. All necessary terminating loads should be included in the tender and their ratings should be indicated.

9. An interlock & mimic LED display system should be included. This should take care of patching arrangement of transmitters. Details should be given in the tender.
10. Metering Arrangements for Forward & Reflected power measurement at each Input port and Output port of the Diplexer shall be provided. Full details should be forwarded along with the Tender.
11. The Transmitter outputs are available on 3-1/8" unflanged rigid coaxial lines. The output of the Diplexer will be connected through 3-1/8" unflanged rigid coaxial lines to 3-1/8" dia feeder cable having 3-1/8" EIA Flange connector.
12. Recommended spares should be quoted separately. This list should be based upon actual failure pattern observed in previous supplies.
13. Diplexer should be guaranteed for a period of 2 years from the date of supply at site in good condition or 18 months from date of completion of SETC whichever is later.
14. Inspection/Acceptance tests as per approved ATP will be carried out at the diplexer OEM works. It will be the responsibility of the Supplier to arrange equipment and instruments for inspection. This will include a set of full measurements and checking change of frequency & retuning. One copy of Manual including Tuning process should be forwarded within two months of Supply Order. Charges for inspection, if any, may be quoted separately.
15. Final performance measurements of the diplexer and accessories as per specification is required to be taken at site after successful completion of erection & commissioning alongwith graphical printouts of the measurements like VSWR/return-loss & isolation for entire frequency range of 88 MHz to 108 MHz.
16. Earthing work: Two independent earth systems will be provided by the tenderer/OEM as per IS. The value of earth resistance of each system will be less than 1 ohm.
17. GUARANTEE: Tenderer shall submit with his tender an undertaking to accept the following guarantees:
  - (i) A guarantee that the equipment supplied will be in accordance with these specifications, varied only to the extent stated in his tender and agreed to in the contract.
  - (ii) A guarantee to make good within 30 days at his own expense any component which becomes defective under normal operating conditions within 18 months from the date of acceptance of the equipment at respective site.
  - (iii) A guarantee to supply all components for a period of 10 years from the date of acceptance of equipment at site, at rates at which these are being supplied by him to other customers & also should match prices of original manufactures of these components prevailing at the time.
  - iv) If at any stage, during next 10 years, the manufacturer stops production of this model of equipment, he shall intimate All India Radio in advance to enable the later to stock the critical items.

### 3.2 RF COAXIAL COPPER RIGID LINES & ACCESSORIES :

#### RF COAXIAL COPPER RIGID LINES & ACCESSORIES FOR COMPLETENESS OF SYSTEM

##### 1.0 Technical Specification of RF Coaxial Copper Rigid lines (50 Ohm):

S. No.	TECHNICAL PARAMETER	TECHNICAL SPECIFICATION
1.1	Size	3-1/8"
1.2	VSWR	≤1.1:1.0
1.3	Attenuation (100 MHz) at 20°C	≤ 0.35 dB/100M
1.4	Average power handling capacity at ambient temperature 40°C (100 MHz)	≥ 45 kW
1.5	Frequency Range	88-108 MHz
1.6	Material	High conductivity copper

##### 2.0 Additional Hardware: (Impedance: 50 ohm)

- |     |  |           |
|-----|--|-----------|
| 2.1 | 3-1/8" RF coaxial Rigid Line with inners, bullets & insulators | - 18 M    |
| 2.2 | 3-1/8" Elbows with inner and bullets & insulators              | - 7 nos.  |
| 2.3 | 3-1/8" Couplings with inners, bullets& insulators              | - 10 nos. |
| 2.4 | 3-1/8" Field Flange with inners, bullets& insulators           | - 2 nos.  |
| 2.5 | 3-1/8" to N Test Reducer                                       | - 1 no.   |
| 2.6 | 1-5/8" to N Test Reducer                                       | -1 no.    |
| 2.7 | Hanger for 3-1/8" RF coaxial Rigid Line                        | -12 nos.  |
| 2.8 | Any accessories offered for the completeness of the system     | - 1 Lot   |

(Items wise details of offered and included material , items & part are to be given by the Tenderer )

**GUARANTEE:** Tenderer shall submit with his tender an undertaking to accept the following guarantees:

- (i) A guarantee that the equipment supplied will be in accordance with these specifications, varied only to the extent stated in his tender and agreed to in the contract.
- (ii) A guarantee to make good within 30 days at his own expense any component which becomes defective under normal operating conditions within 18 months from the date of acceptance of the equipment at respective site.
- (iii) A guarantee to supply all components for a period of 10 years from the date of acceptance of equipment at site, at rates at which these are being supplied by him to other customers & also should match prices of original manufactures of these components prevailing at the time.
- (iv) If at any stage, during next 10 years, the manufacturer stops production of this model of equipment , he shall intimate All India Radio in advance to enable the later to stock the critical items.

#### **4.0 INSPECTION AT MANUFACTURER'S WORKS:**

**Annexure -I**

##### **1.0 INSPECTION DETAILS AT MANUFACTURE WORKS**

The inspection for acceptance of the diplexer and RF Coaxial Copper rigid lines etc. will be carried out at the Works of the Manufacturer of the main Equipment i.e Diplexer in accordance with approved Acceptance Test Procedure (ATP) by AIR.

All facilities like complete set of measuring instruments, power supply, manual assistance, etc. will be provided by the supplier without any additional charges. Inspection will be as per Specification. Engineers of All India Radio will carry out detailed inspection at manufacturer's works.

Prior intimation for carrying out inspection and pre-despatch performance test as per ATP at works is to be given by the OEM to the indenter at least 6 weeks in advance.

Inspection period for Diplexers, RF Coaxial Copper Rigid Lines & accessories shall be 2 working days total at the manufacturer's works.

Complete Acceptance Test Procedure (ATP) will be prepared by the manufacturer and submitted to Indentor for approval within one month of placement of order by AIR. This Procedure after modification (if required during the process of approval) shall form the basis for Performance/Inspection Tests to be carried out. ATP will also indicate full details of set up for measuring/testing equipment to be deployed during the Performance Measurement/Inspection Test at factory.

Operation checking of the diplexer and RF Coaxial rigid lines etc and measurements will be carried out at any three frequencies in the VHF band, 88 to 108 MHz. Complete set of instruments will be made available in advance.

#### **INSPECTION:**

The Tenderer shall quote charges for Inspection of diplexer, RF Coaxial Copper Rigid Lines & accessories at manufacturer's works by two AIR Engineers for 2 working days in respect of all equipment/items of Section 5.0 of AIR Specification.

<b>S. No.</b>	<b>DESCRIPTION</b>	<b>QTY</b>	<b>UNIT</b>
1	Charges for inspection at manufacturer's works by two AIR Engineers for 2 working days in respect of Diplexer & RF Coaxial Copper Rigid Lines & accessories.(Site-Srinagar)	1 job	job

**TOTAL AMOUNT: (In figures and words)**

Signature of Tenderer & OEM with date and seal  
Full Name in CAPITAL LETTERS

**SECTION 5.0 SCHEDULE OF SUPPLY, ERECTION, TESTING & COMMISSIONING FOR SRINAGAR**

**SECTION 5.1 SCHEDULE OF SUPPLY FOR SRINAGAR**

S.No.	DESCRIPTION	Quantity	UNIT
1	Supply of Diplexer complete as per Section 3.1 of AIR Specification along with complete hardware material.	1set/System	set/ system
2	Supply of any accessories offered for the completeness of the system ( Items wise details of offered and included material are to be given by the Tenderer )	1 Lot	
3	Supply of additional hardware material as per Section 3.2 of AIR Specification as given below		
3.1	3-1/8" RF coaxial Rigid Line with inners, bullets & insulators	18 mtr.	M
3.2	3-1/8" Elbows with inners, bullets & insulators	7 nos.	each
3.3	3-1/8" Couplings with inners, bullets & insulators	10 nos.	each
3.4	3-1/8" Field Flange with inners, bullets & insulators	2 nos.	each
3.5	3-1/8" to N Test Reducer	1 no.	each
3.6	1-5/8" to N Test Reducer	1 no.	each
3.7	Hanger for 3-1/8" RF coaxial Rigid Line	12 nos.	each

**TOTAL AMOUNT: (In figures and words)**

Signature of Tenderer & OEM with date and seal  
Full Name in CAPITAL LETTERS

**SECTION 5.2 SCHEDULE OF ERECTION, TESTING & COMMISSIONING FOR SRINAGAR**


S. No.	DESCRIPTION	Quantity	UNIT
1	Erection, Testing & commissioning (ETC) of Diplexer and other accessories (S. No.1,2&3 of Section 5.1) etc as per AIR Specifications	1 job	job
2	Providing independent <b>Earth System</b> 2 Nos. including all material & labour as per IS. The value of earth resistance of each earth system shall be less than 1 Ohm.	1 job	job

**TOTAL AMOUNT: (In figures and words)**

Signature of Tenderer & OEM with date and seal  
Full Name in CAPITAL LETTERS


1561

# SCHEMATIC DIAGRAM OF DIPLEXER AT SRINAGAR (STUDIO SITE)

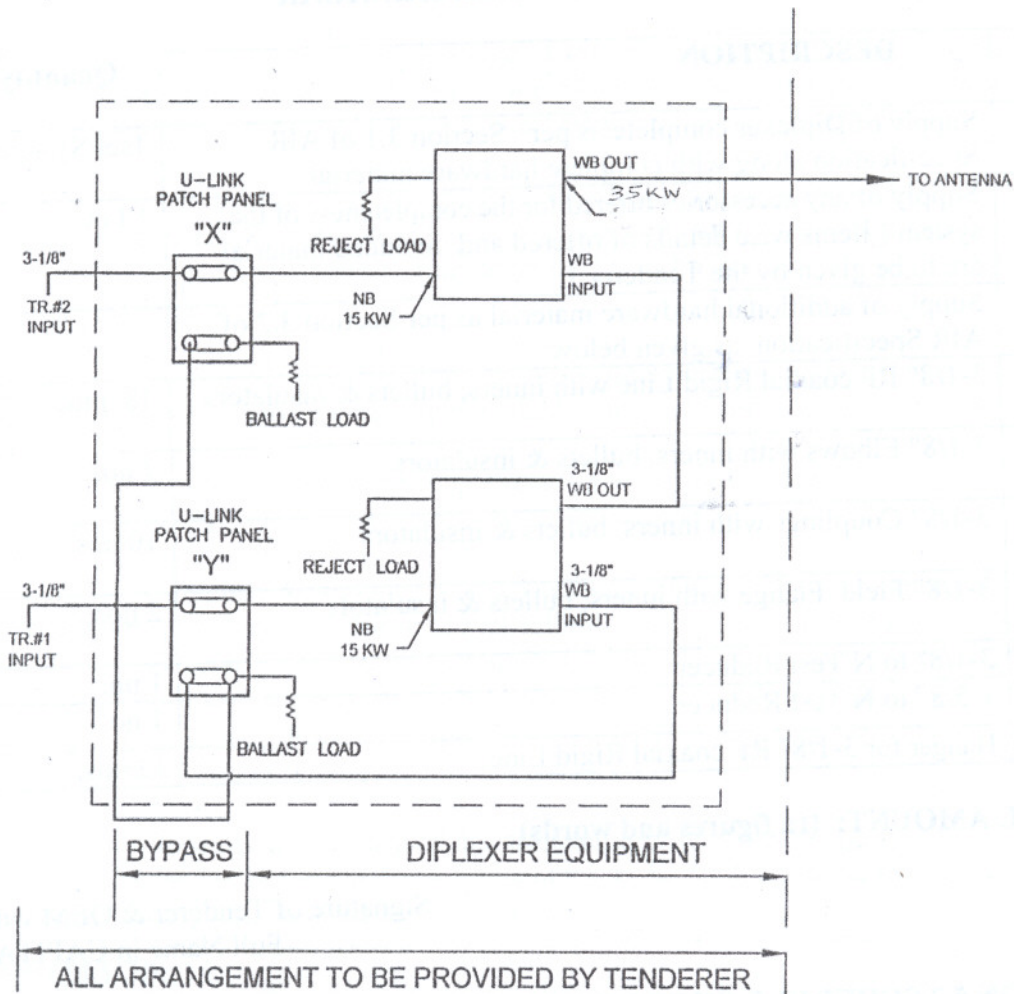

### NOTES:-

1. THE REJECT LOAD, INTERLOCK CIRCUIT, LED MIMIC DIAGRAM WITH ALL RIGID LINE CONNECTION, U-LINK PATCH PANEL ETC. TO BE PROVIDED BY OEM/TENDERER.
2. METERING ARRANGEMENT FOR FORWARD & REFLECTED POWER TO BE PROVIDED BY OEM/TENDERER ON INPUT & OUTPUT SIDES.
3. ALL NECESSARY HARDWARE FOR BYPASSING ARRANGEMENT TO BE AN INTEGRAL PART OF THE DIPLEXER.
4. TWO SETS OF EARTHINGS AS PER I:S TO BE PROVIDED BY OEM/TENDERER.



TR.#1 BYPASSED

SEPT.2008		ALL INDIA RADIO P&D UNIT NEW DELHI
DATE	DRN	
A.E.	D.D.E	DRG. No. TM-15832